



NOTES:

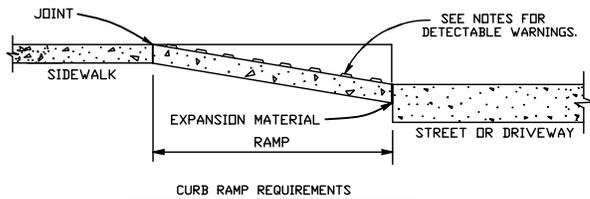

CURB RAMP REQUIREMENTS


ANY SIDEWALK NOT LEVEL WITH A DRIVEWAY OR STREET WILL BE REQUIRED TO HAVE A RAMP WITH A MAXIMUM SLOPE RATIO OF 1 VERTICAL TO 12 HORIZONTAL. N.T.S.




SECTION THRU

TRUNCATED DOMES
(ADAAG DETECTABLE WARNINGS ON WALKING SURFACES 05/06/02)
N.T.S.

PARTIAL PLAN SHOWING 2'-0" OFFSET FOR TRUNCATED DOMES
N.T.S.



- TRUNCATED DOMES IN A DETECTABLE WARNING SURFACE SHALL HAVE A BASE DIAMETER OF 0.9 INCHES (23 mm) MINIMUM TO 1.4 INCHES (36 mm) MAXIMUM, A TOP DIAMETER OF 50% OF THE BASE DIAMETER MINIMUM TO 65% OF THE BASE DIAMETER MAXIMUM, AND A HEIGHT OF 0.2 INCHES (5 mm).
- TRUNCATED DOMES IN A DETECTABLE WARNING SURFACE SHALL HAVE A CENTER-TO-CENTER SPACING OF 1.6 INCHES (41 mm) MINIMUM AND 2.4 INCHES (61 mm) MAXIMUM, AND A BASE-TO-BASE SPACING OF 0.65 INCHES (16 mm) MINIMUM, MEASURED BETWEEN THE MOST ADJACENT DOMES ON SQUARE GRID.
- TRUNCATED DOMES SURFACES SHALL CONTRAST VISUALLY WITH ADJACENT WALKING SURFACES EITHER LIGHT-OR-DARK, OR DARK ON LIGHT.
- THE MATERIAL USED TO PROVIDE CONTRAST SHALL BE AN INTEGRAL PART OF THE WALKING SURFACE. DETECTABLE WARNINGS USED ON INTERIOR SURFACES SHALL DIFFER FROM ADJOINING WALKING SURFACES IN RESILIENCY OR SOUND-ON-CANE CONTACT.
- TRUNCATED DOMES ON CURB RAMPS WITHIN THE STREET R.O.W. SHALL BE CAST-IN-PLACE, PREFABRICATED DETECTABLE WARNING UNITS INSTALLED DIRECTLY IN WET CONCRETE. SURFACE APPLIED OR SURFACE MOUNTED SYSTEMS WITH MECHANICAL OR ADHESIVE ANCHORAGE ARE NOT ACCEPTABLE.
- TRUNCATED DOMES SHALL COVER AT LEAST 2 FEET IN DEPTH AND EXTEND FULL WIDTH OF THE RAMP. ANY RAMP HAVING FLARED SIDES WILL NOT BE REQUIRED TO HAVE THESE DETECTABLE WARNINGS ON THE FLARES.
- THE LIMITS OF THE MAIN SURFACE OF THE RAMP ON WHICH THE DETECTABLE WARNINGS ARE PLACED SHALL HAVE A REDDISH COLOR SIMILAR TO THAT OF "TERRA COTTA". THE COLOR MUST BE APPROVED BY JEFFERSON PARISH DEPARTMENT OF ENGINEERING.
- STAMPING OF TRUNCATED DOMES WITHIN THE R.O.W. WILL NOT BE ALLOWED.

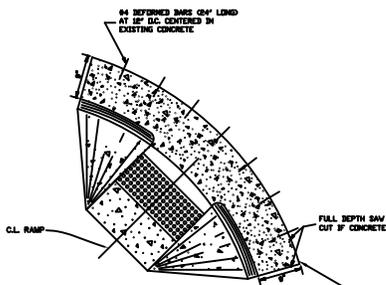


HANDICAPPED RAMP RETROFIT DETAIL


NOTE FOR HANDICAPPED RAMP CONNECTION TO EXISTING ROAD

FOR CONCRETE ROADWAY CONTRACTOR SHALL MAKE FULL DEPTH SAW-CUT TO REMOVE THE PORTION OF EXISTING ROADWAY AND INTEGRAL CONCRETE CURB WITHIN THE LIMITS SHOWN AND REPLACE WITH HANDICAPPED ACCESSIBLE CURBING. IF CURB IS NOT POURED MONOLITHICALLY, CONCRETE WILL NEED TO BE DEPRESSED THREE (3) INCHES AT CURB LOCATIONS TO ALLOW FOR CURB DOWELS.

FOR ASPHALT ROADWAY CONTRACTOR SHALL MAKE FULL DEPTH SAW-CUT TO REMOVE EXISTING CURB AND GUTTER (AND POSSIBLE ASPHALT OVERLAY), AND REPLACE WITH HANDICAPPED ACCESSIBLE CURBING. IF CURB IS NOT POURED MONOLITHICALLY WITH GUTTER, CONCRETE WILL NEED TO BE DEPRESSED THREE (3) INCHES AT CURB LOCATIONS TO ALLOW FOR CURB DOWELS.

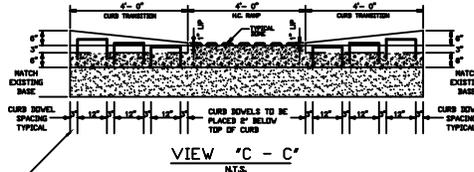


VIEW "C - C"
N.T.S.

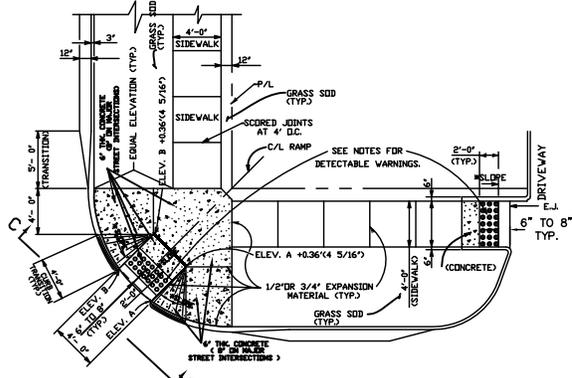


PLAN OF TYPICAL SIDEWALK WITH RAMP FOR HANDICAPPED

* **MAXIMUM RAMP SLOPE**
12 HORIZONTAL
1 VERTICAL



PARTIAL PLAN SHOWING 2'-0" OFFSET FOR TRUNCATED DOMES
N.T.S.



PARTIAL PLAN OF TRUNCATED DOMES
(ADAAG DETECTABLE WARNINGS ON WALKING SURFACES 05/06/02)
N.T.S.

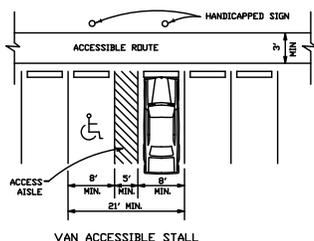


FIG. A

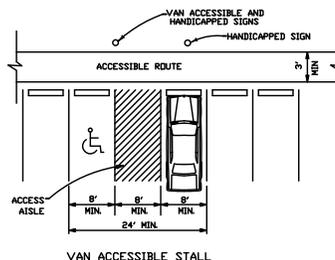


FIG. B

PARKING SPACE REQUIREMENTS

NOTE:

PARKING SPACES FOR PHYSICALLY HANDICAPPED PEOPLE SHALL BE AT LEAST 8' WIDE AND SHALL HAVE AN ADJACENT ACCESS AISLE 5' WIDE MINIMUM (SEE FIG. A). PARKING ACCESS AISLE SHALL BE PART OF THE ACCESSIBLE ROUTE TO THE BUILDING OR FACILITY ENTRANCE. TWO ACCESSIBLE PARKING SPACES MAY SHARE A COMMON ACCESS AISLE. PARKED VEHICLE OVERHANGS SHALL NOT REDUCE THE CLEAR WIDTH OF AN ACCESSIBLE CIRCULATION ROUTE. ACCESSIBLE PARKING SPACES SHALL BE DESIGNATED AS RESERVED FOR PHYSICALLY HANDICAPPED PEOPLE BY A SIGN SHOWING THE SYMBOL OF ACCESSIBILITY. SUCH SIGNS SHALL NOT BE OBLSCURED BY A VEHICLE PARKED IN THE SPACE.

NOTE:

FOR PRE-POUR INSPECTION CALL THE DEPARTMENT OF ENGINEERING AT 736-6793 FOR APPOINTMENT.

COMMERCIAL PLAN
OF DETAIL NO. 5
NOT TO SCALE

JEFFERSON PARISH DEPARTMENT OF ENGINEERING

HANDICAPPED REQUIREMENTS

REVIEWED BY: C.J.	DATE: 06/25/10	REVIEWED BY: T.V.C.	DATE: 08/05/93	REVIEWED BY: H.J.W.	DATE: 09/26/97
REVIEWED BY: C.J.	DATE: 10/08/10	REVIEWED BY: H.J.W.	DATE: 07/26/02	REVIEWED BY: H.J.W.	DATE: 02/01/05
REVIEWED BY: C.J.	DATE: 05/13/11	REVIEWED BY: H.J.W.	DATE: 02/16/05	REVIEWED BY: H.J.W.	DATE: 06/23/05
REVIEWED BY: C.J.	DATE: 09/24/15	REVIEWED BY: J.L.	DATE: 06/01/07	REVIEWED BY: C.H.S.	DATE: 01/30/09
REVIEWED BY: -	DATE: -	REVIEWED BY: J.C.	DATE: 06/25/10	DATE: -	DATE: -

APP: AUTOCAD 2000/L.T. 2000
FILE NUMBER: ENV-09
DETAIL -5(2000).DWG